


**NOTES:**


1. RAMPS TO BE POURED SEPARATELY AND ISOLATED BY 3/8" EXPANSION JOINT MATERIAL.
2. CENTER RAMP ON CENTERLINE OF CROSSWALK.
3. RAMPS SHALL HAVE A MAXIMUM 1:12 SLOPE. IF THE MAXIMUM SLOPE OF 1:12 CANNOT BE ACHIEVED DUE TO THE SLOPE OF THE SIDEWALK, THE LENGTH OF THE CURB RAMP SHALL BE A MAXIMUM OF 15 FEET REGARDLESS OF THE RESULTING RAMP SLOPE.

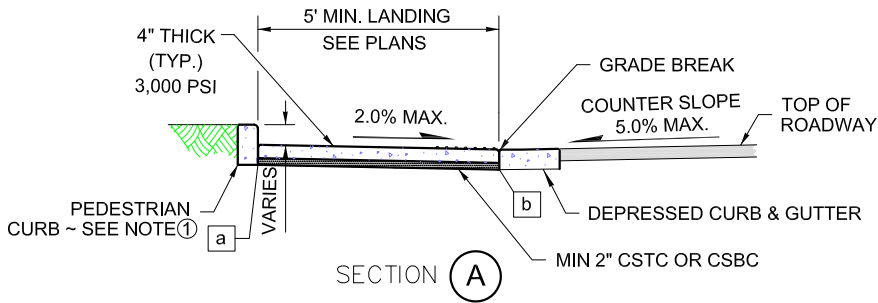

**NOTES:**

SEE STANDARD DETAIL ST-24

- a EXPANSION JOINT
- b CONSTRUCTION JOINT

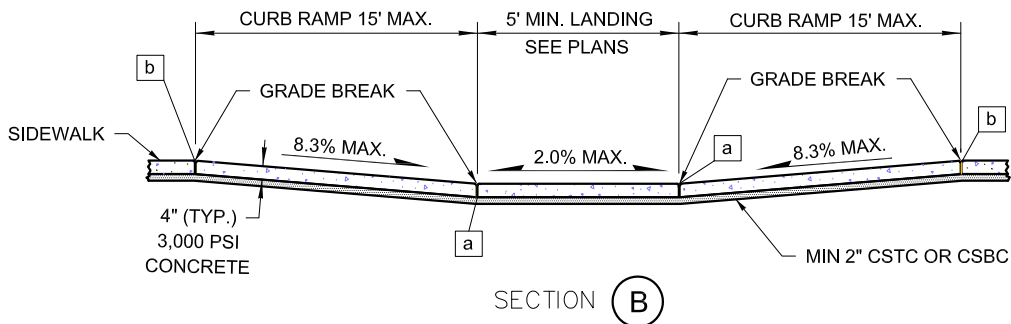

**TYPE 2 CURB RAMP-MIDBLOCK**

PLAN #



CITY OF LA CENTER APPROVED

*Anthony Seoloper*

4/3/17

CITY ENGINEER

DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	9/23/10	BES	BES
2	4/3/17	ALC	ALC

ST-8