


**NOTES:**

1. RAMP TO BE POURED SEPARATELY AND ISOLATED BY 3/8" EXPANSION JOINT MATERIAL.
2. CENTER RAMP ON CENTERLINE OF CROSSWALK.
3. RAMP SHALL HAVE A MAXIMUM 1:12 SLOPE. IF A SLOPE OF 1:12 CANNOT BE ACHIEVED DUE TO THE SLOPE OF THE SIDEWALK, THE LENGTH OF THE CURB RAMP SHALL BE A MAXIMUM OF 15' REGARDLESS OF THE RESULTING RAMP SLOPE.

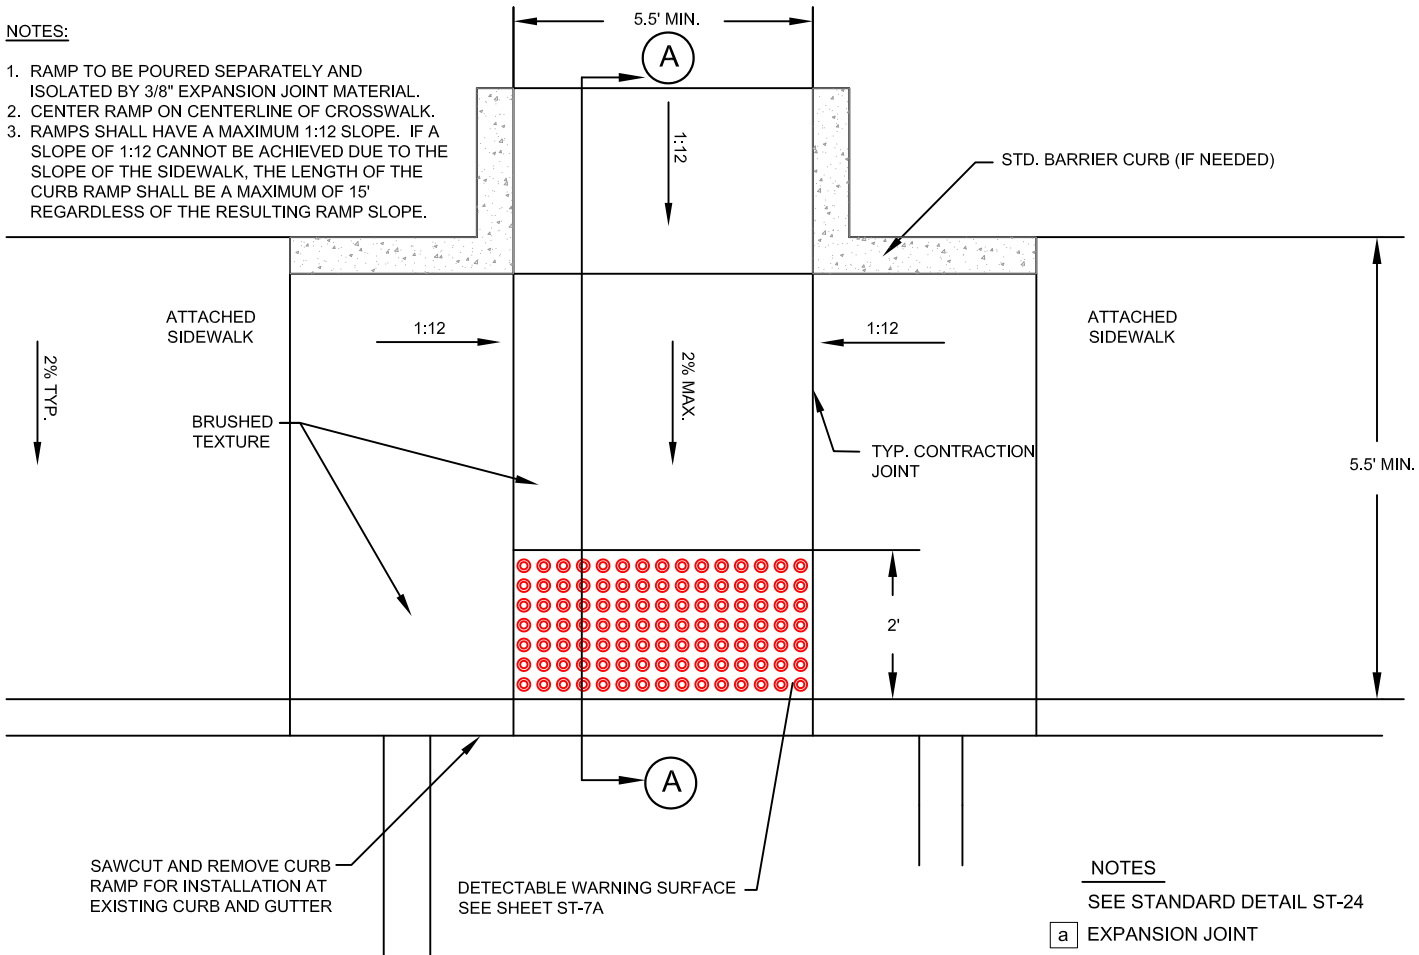

SAWCUT AND REMOVE CURB RAMP FOR INSTALLATION AT EXISTING CURB AND GUTTER


DETECTABLE WARNING SURFACE SEE SHEET ST-7A

**NOTES**

SEE STANDARD DETAIL ST-24

**a** EXPANSION JOINT

**b** CONSTRUCTION JOINT

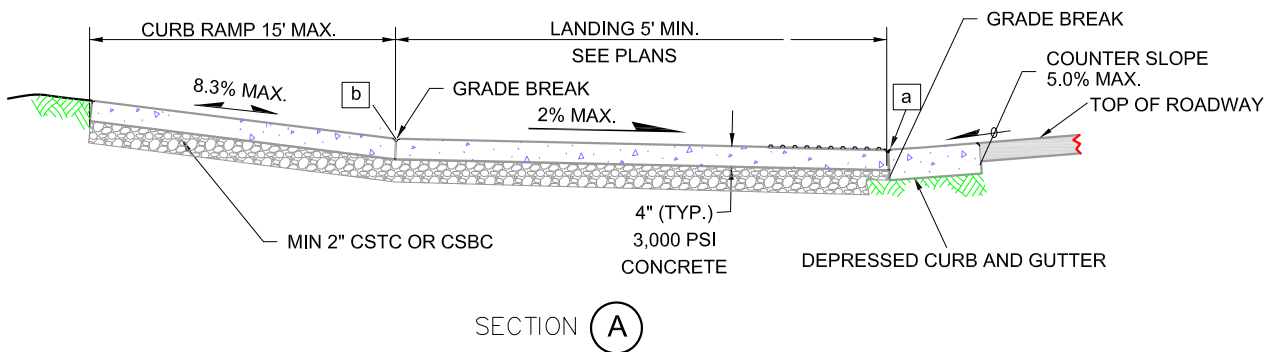

SECTION **A**

**TYPE 2B CURB RAMP**

PLAN #

CITY OF LA CENTER APPROVED

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	9/23/10	BES	BES
2	4/3/17	ALC	ALC

*Anthony Scelopero*

4/3/17

CITY ENGINEER

DATE

ST-9

